


MODULATING ULTRA FORCE SUF - ONE WATER HEATER WITH VERTICAL STORAGE TANK, FORCED RECIRCULATION AND BUILDING RECIRCULATION (ONE TEMPERATURE)

LEGEND

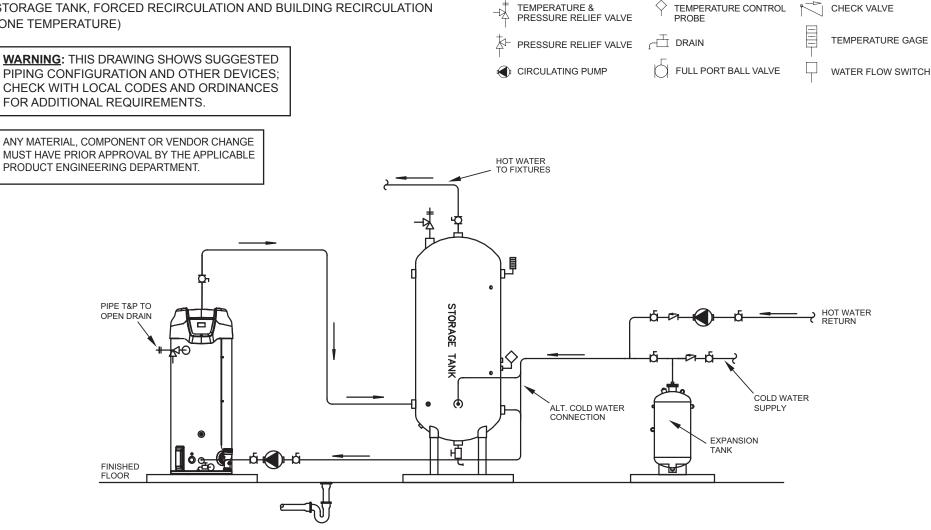

NOTES:

- 1. Preferred piping method.
- 2. The temperature and pressure relief valve setting shall not exceed pressure rating of any component in the system.
- 3. Service valves are shown for servicing unit. However, local codes shall govern their usage.
- 4. The tank temperature control should be wired to and control the pump between the water heater(s) and the storage tank(s).
- 5. The water heater's operating thermostat should be set 5 degrees F higher than the tank temperature control.

June 2014 | Printed in U.S.A. | © State Water Heaters For Technical Information and Automated Fax Service, call 800-265-0024 or visit http://www.statewaterheaters.com. State Water Heaters reserves the right to make product changes or improvements without prior notice.